ATTACHMENT 2

Dominion Virginia Power
701 East Cary Street, Richmond, VA 23219

Mailing Address: P.O. Box 26666
Richmond, VA 23261

dom.com

Dominion

CITY MANAGER'S OFFICE
ALEXANDRIA, VA
2016 AUG 23 A 11: 28

August 19, 2016

Mr. Mark Jinks
City Manager - Alexandria City Hall
301 King Street
Alexandria, VA 22314

RE: Dominion Virginia Power's Arlington/Alexandria/Fairfax Reliability Project

Dear Mr. Jinks:

As part of the State Corporation Commission process, and in conjunction with our discussions and meetings with City staff, we formally notify local jurisdictions when we are nearing filing of a transmission project. As you are aware, we were initially planning to file in late 2014; however, the project was delayed until 2016 for additional electrical planning analysis.

The basis for the project remains the same as in 2014. In order for Dominion to continue to provide reliable electric service to local customers, consistent with North American Electric Reliability Corporation (NERC) Reliability Standards, Dominion is analyzing two potential electrical solutions. The first option, known as 230 kV Glebe-Potomac River Substation, requires a new 230kV underground transmission line from Dominion's existing Glebe Substation in Arlington County to Pepco's existing Potomac River Substation in the City of Alexandria. Additional infrastructure improvements will be required at Glebe Substation and Potomac River Substation. The second option, known as Alternative 1, requires the re-conductor, rebuild, and ampacity uprate of sections of existing overhead and underground lines in Fairfax County and the City of Alexandria. Additional infrastructure improvements will also be required at multiple Dominion Substations.

Dominion intends to file an application this year with the Virginia State Corporation Commission (SCC) to obtain approval for either the Glebe –Potomac River Substation Route or Alternative 1 and in accordance with Section 15.2-2202 of the Code of Virginia, respectfully invites you to share any comments on both options. Attached you will find two maps, one identifying the Glebe –Potomac River Substation Route and the other identifying Alternative 1.

We look forward to continuing discussions with elected officials and staff. Should you have any questions, please contact me at (804) 771-4061 or Benjamin.A.Saunders@dom.com or Travis Cutler at (571) 203-5016 or travis.k.cutler@dom.com .

Sincerely,

Ben Saunders

Ben Saunders
Dominion – Senior Siting and Permitting Specialist

c: Mr. Yon Lambert
Travis Cutler

LEGEND

Transmission Route

230kV GLEBE TO POTOMAC RIVER SUBSTATION ROUTE

City of Alexandria, VA

Arlington County, VA

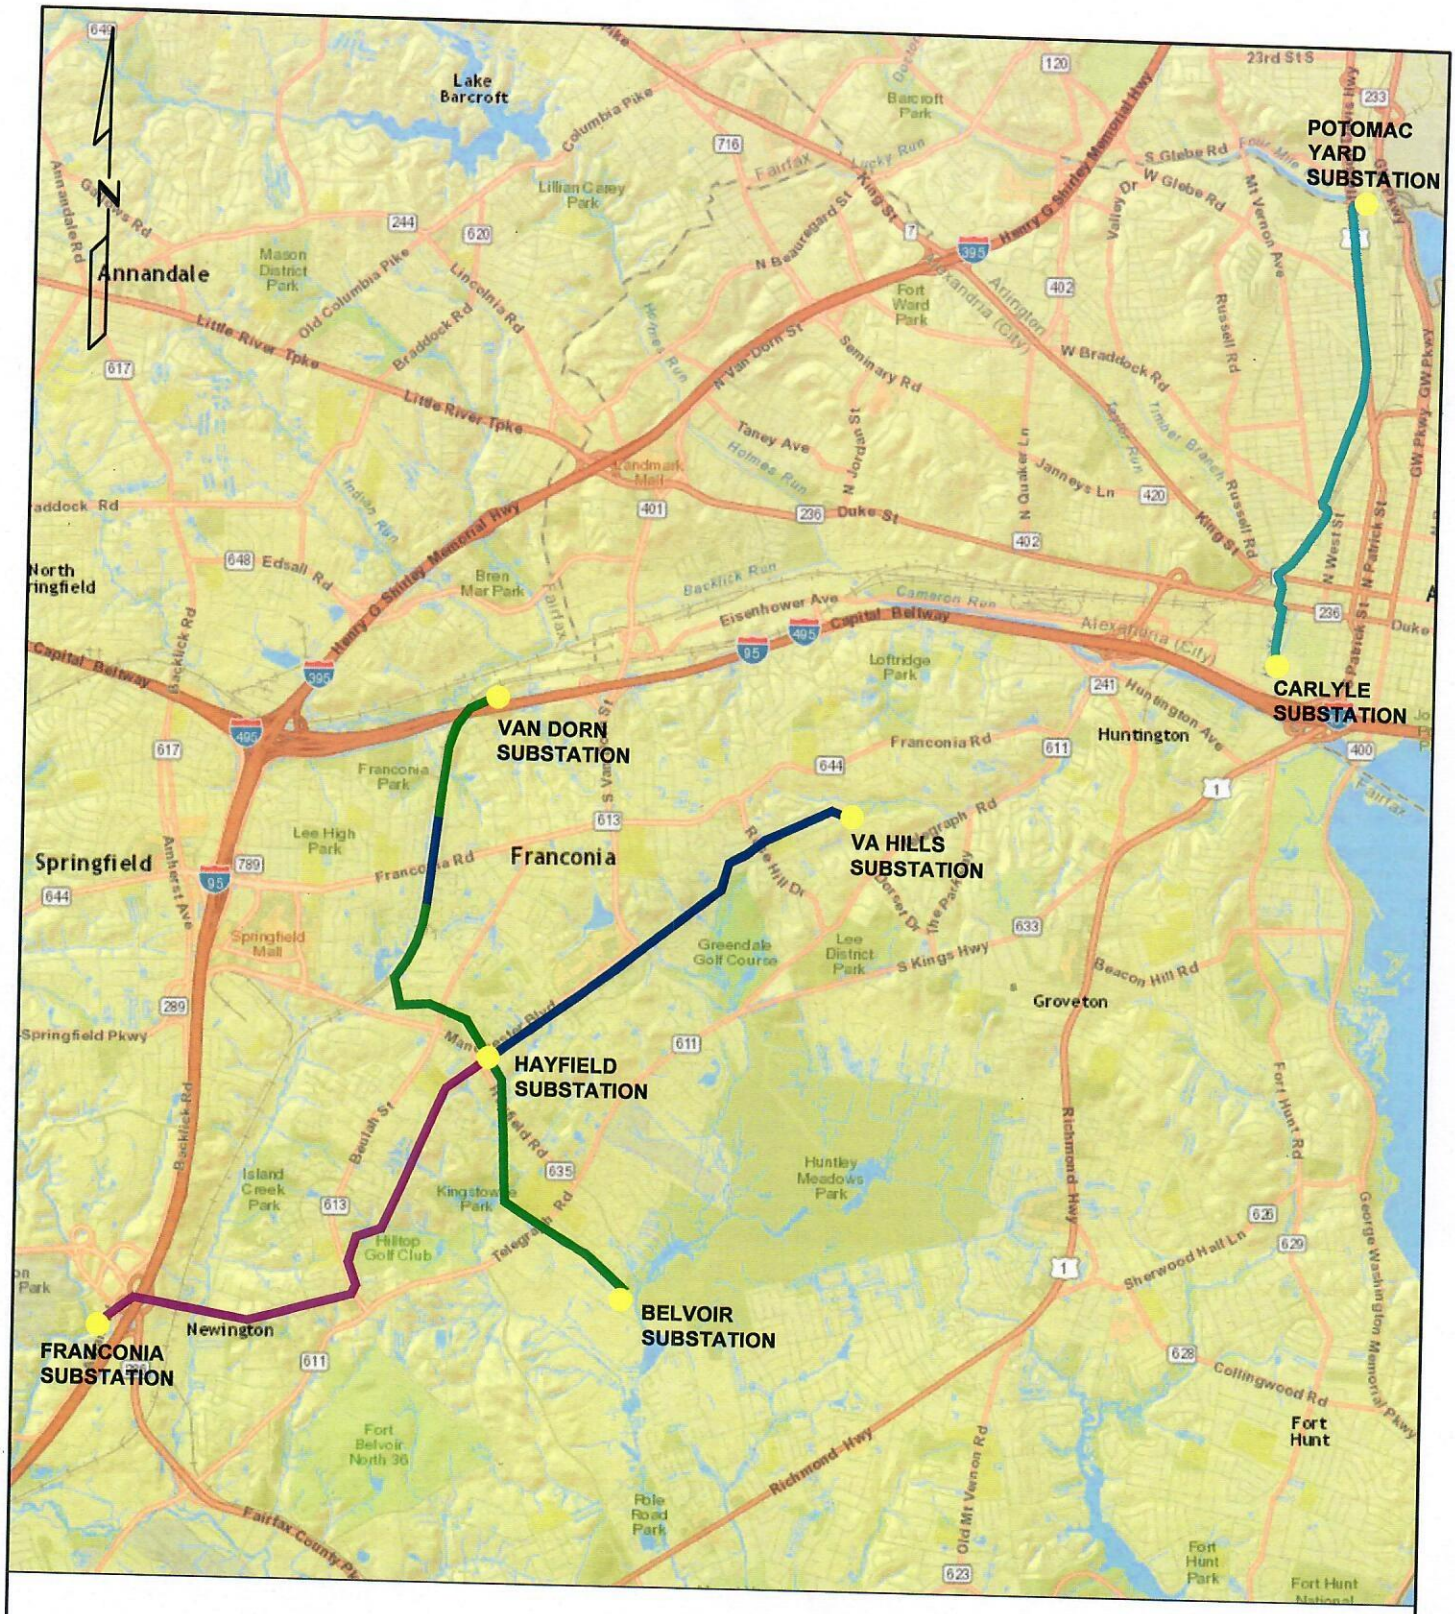

ALTERNATIVE 1

Arlington, Fairfax, and City of Alexandria