


**Attachment One**  
**Project Driver Map**

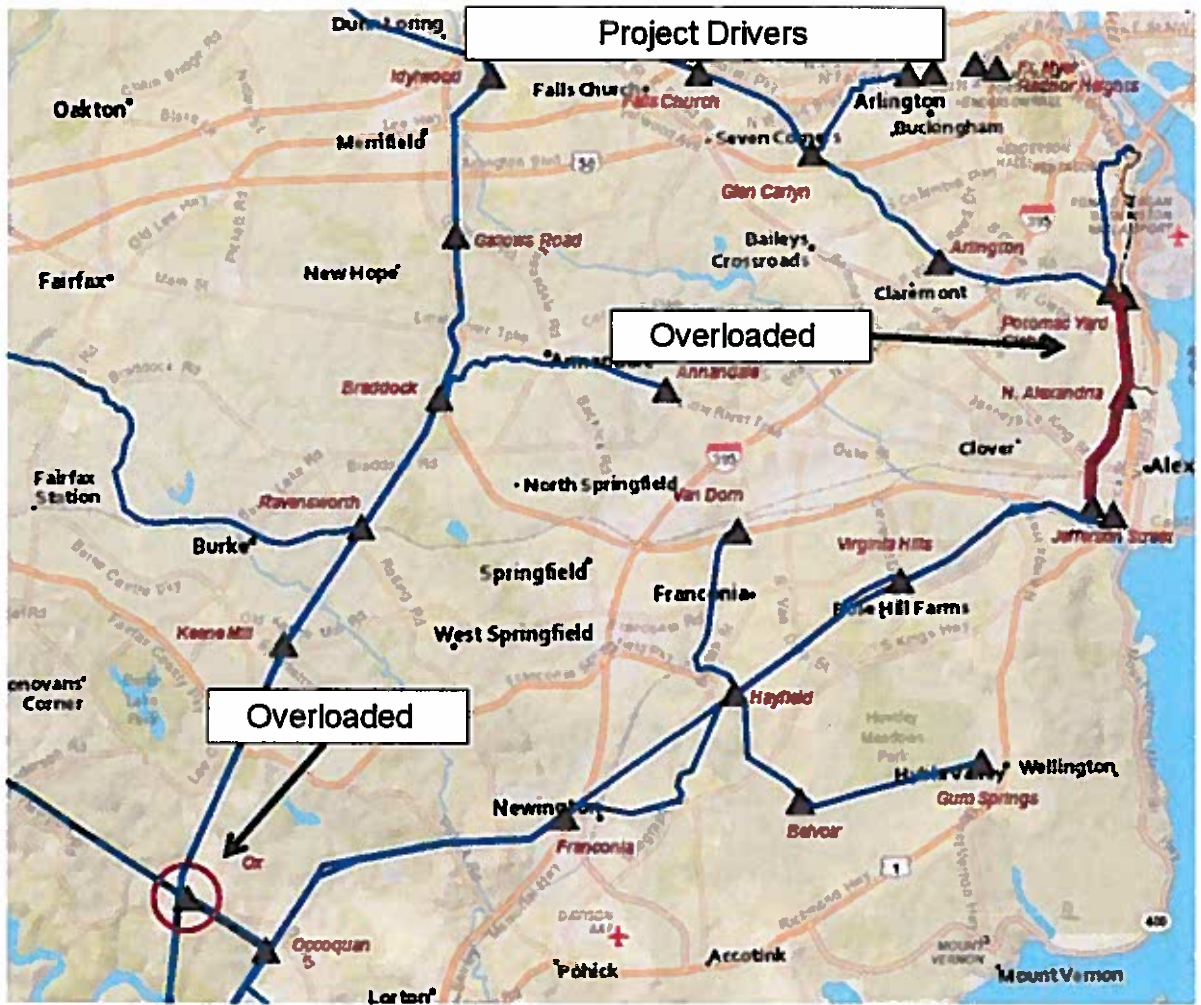

**Attachment Two**  
**Power Flow Summary**

**Summer 2020  
Preliminary Power Flow Summary**

		MAX N-1-1 Contingency Flow				
Line #	Monitored Element	Rate A	Rate B	MVA	% Loading	%SCRD
<u>Base System – No Project</u>						
248	314064 6N POT YD 230 314126 6S CARL 230 1	603	603	619.9	102.8	101.7
Tx 1	314919 8OX 314068 6OX 230 1	909.3	951.9	1048.3	110.1	107.1
Tx 2	314919 8OX 314068 6OX 230 2	931.9	963.8	1052.4	109.2	106.2
<u>Base System – With Project</u>						
248	314064 6N POT YD 230 314126 6S CARL 230 1	603	603	602	<100%	<100%
Tx 1	314919 8OX 314068 6OX 230 1	909.3	951.9	950.0	<100%	<100%
Tx 2	314919 8OX 314068 6OX 230 2	931.9	963.8	958.1	<100%	<100%

**Attachment Three  
With No Project**



**Attachment Four  
With Proposed Project**

